



UL Solutions Evaluation Report

ULC ER40477-01

Issued: October 10, 2023

Visit the UL Solutions [Product iQ® database](#) for current status of report.

UL Solutions Category Code: ULEY7 – Weather Barrier for Canada

CSI MasterFormat®

DIVISION: 07 10 00 - Dampproofing and Waterproofing

Sublevel 2: 07 14 00 - Fluid Applied Waterproofing

Sublevel 3: 07 14 16 - Cold Fluid-Applied Waterproofing

COMPANY:

Huntsman Building Solutions

870 Cure-Boivin

Boisbriand, QC

J7G 2A7

www.huntsmanbuildingsolutions.com

1. Subject:

COATLOK U-192

2. Scope of evaluation

2015 National Building Code of Canada, NBCC (Sept. 28, 2018)

2020 National Building Code of Canada, NBCC (July 15, 2019)

Clause 1.2.1.1.(1)(a) Compliance with this Code (Acceptable Solution from Division B)

Part 5 – Environmental Separation

Article 5.9.1.1 Compliance with Applicable Standards

Part 9 – Housing and Small Buildings

Clause 9.25.2.2.(1)(h) Insulation Materials

Article 9.25.2.5 Installation of Spray-Applied Polyurethane

Clause 1.2.1.1.(1)(b) Compliance with this Code (Alternate Solution from Division B)

Part 9 – Housing and Small Buildings

Article 9.13.2.2 Dampproofing Materials

Article 9.13.3.2 Waterproofing Materials

The products underwent evaluation for the following properties:

- Waterproofing membrane physical properties (thickness, tensile strength, water absorption, water vapour permeance, low temperature flexibility, crack bridging, peel adhesion strength, biological resistance, UV exposure, hydrostatic pressure)
- SPUF physical properties (CAN/ULC-S705.1)
- SPUF application (CAN/ULC-S705.2)
- Frost heaving performance

3. Reference documents

ASTM C1306 Hydrostatic Pressure Resistance of a Liquid-applied Waterproofing Membrane

ASTM D5385 Hydrostatic Pressure Resistance of Waterproofing Membranes

ASTM E96 Water Vapour Transmission of Materials

ASTM E154 Standard Test Methods for Water Vapor Retarders used in Contact with Earth Concrete Slabs, on Walls, or as Ground Cover

CAN/CGSB-37.50 Hot-Applied, Rubberized Asphalt for Roofing and Waterproofing

CAN/CGSB-37.58 Membrane, Elastomeric, Cold-Applied Liquid, for Non-Exposed Use in Roofing and Waterproofing

CAN/ULC-S705.1 Standard for Thermal Insulation, Spray Applied Rigid Polyurethane Foam, Medium Density - Material Specification

CAN/ULC-S705.2 Standard for Thermal Insulation, Spray Applied Rigid Polyurethane Foam, Medium Density - Application

4. Uses

The Huntsman Building Solutions **COATLOK U-192** membrane is intended for use as a building foundation waterproofing membrane in housing and small buildings with cast concrete or concrete masonry units (CMU) foundation walls.

UL Solutions Evaluation Report

This Report does not address the use of the COATLOK U-192 for extended periods of the material exposure prior to backfilling, deep foundations, pressure treated wood or insulated concrete form (ICF) foundations, areas of contaminated soil conditions, puncture / impact resistance of the membrane or soil gas control requirements. Additional evaluations and testing other than noted in this Report are typically required to meet these and other applications.

5. Product description

The COATLOK U-192 is a spray applied elastomeric polyurea, waterproofing membrane intended for the waterproofing of below-grade concrete foundation walls. The material is applied by Huntsman Building Solutions trained / authorized applicators to suitably prepared and primed (COATLOK PRE 206) concrete foundation walls to a minimum 2.5 mm (100 mils) dry film thickness. Backfilling is conducted in accordance with local code requirements including the utilization of a protection board.

An optional application of a spray polyurethane foam (SPF) insulation may be applied to the exterior face of the foundation wall prior to the COATLOK U-192 application. The SPUF serves as a primer for uneven or rough concrete wall surfaces providing a uniform smooth surface for the waterproofing membrane application. The SPF must meet CAN/ULC-S705.1 and be installed in accordance with CAN/ULC-S705.2 by Huntsman Building Solutions trained / authorized applicators. The SPF may be applied to a maximum thickness of 65 mm.

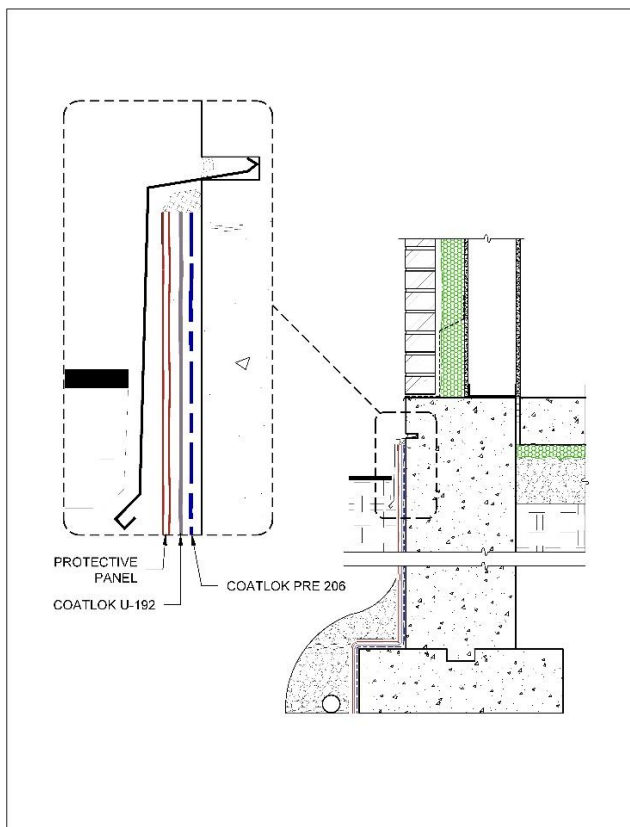


Figure 1
Coatlok U-192 membrane applied
on Coatlok PRE 206 primer

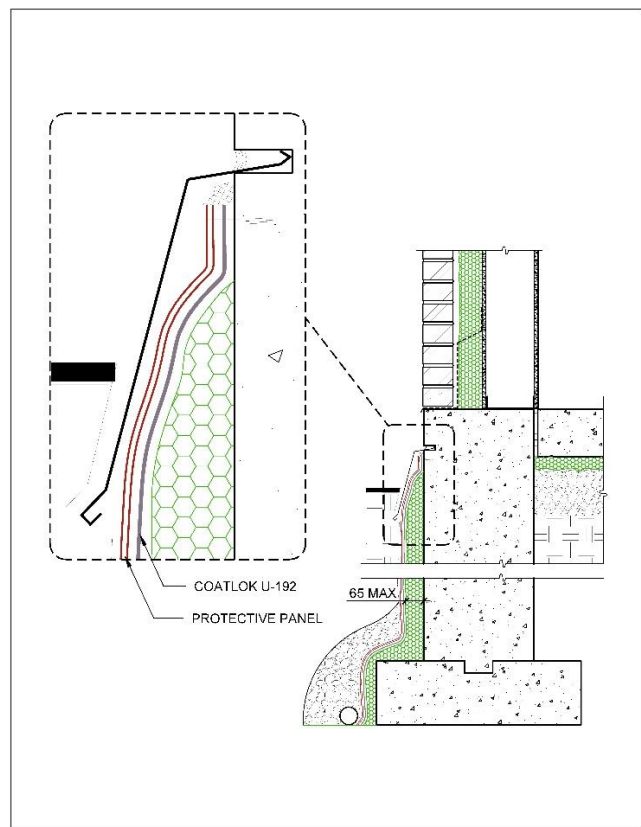


Figure 2
Coatlok U-192 membrane applied on SPF
Heatlok Soya

The COATLOK U-192 elements are under a UL Solutions quality audit program where UL Solutions Field Staff audit material manufacturing facilities, details of the product are on file at UL Solutions and are described by COATLOK U-192 documentation, Revision 1.

6. Performance characteristics

The COATLOK U-192 waterproofing material was evaluated for the performance characteristics as reported below in “Table 1: COATLOK U-192 Performance Characteristics”:

Table 1: COATLOK U-192 Performance Characteristics		
Properties	Requirements	Results
Dry Film Thickness	Report	Min 2.5 mm (100 mils)
Tensile Strength	Report	11.9 kPa
Water Absorption	≤ 3%	-3 / 0 %
Water Vapour Permeance	≤ 43 ng/Pa·s·m ²	20 ng/Pa·s·m ²
Low Temperature Flexibility ¹	-20°C	Compliant
Crack Bridging Resistance ¹	10 cycles at 20°C	Compliant
	30 cycles at -26°C	Compliant
	5 cycles at -26°C (preconditioned)	Compliant
Peel Adhesion Strength ¹	≥ 175 N/m	2,710 N/m
Biological Resistance	No loss of film integrity	Compliant
UV Exposure ¹	90% tensile strength of unaged material	Compliant
Hydrostatic Pressure ¹	≥ 48kPa for 5 days	Compliant

* Note 1 - Substrate primed with COATLOK PRE 206 primer at approx. 5 mils (0.13mm) thickness

SPF Frost Heaving Evaluation

Foundation walls are subject to soil freeze forces during typical Canadian winters. Soil movement due to ice lensing (moisture-susceptible soils freezing and expanding) and adfreezing (ice lenses adhered to cold foundations) may cause differential movement or cracking of the foundation (frost heaving)*. The COATLOK U-192 / SPF waterproofing assembly is required to resist these forces. Laboratory testing was undertaken to evaluate the COATLOK U-192 / SPF waterproofing assembly for freeze / thaw performance, the evaluation was undertaken without the use of the code required protection board.

Representative test samples of SPF at 25 and 65 mm thickness with COATLOK U-192 water proofing membrane (100 mils thickness) applied were placed in a test jig simulating a basement foundation wall assembly. The test jig simulated the interior basement temperature, exterior air (cooling plate) and frost susceptible silt soil (Devon silt). The test jig was instrumented with temperature and vertical displacement sensors. The test assembly was initially subjected to a constant freezing temperature of -12°C for a period of 3 weeks to simulate downward freezing during the winter months. The temperature was then cycled between approximately +10°C and -10°C for periods of 12 to 24 hours to simulate spring freeze-thaw for 100 cycles.

Temperature sensors verified soil freeze-thaw cycling was occurring and that daily frost penetrations of up to 15 cm was achieved. Displacement sensors recorded an initial 1.5 cm heave as the soil froze, and daily heave (~2 mm) and

* Note: Additional information on adfreezing and frost heaving available at NRC Publications, [Adfreezing and frost heaving of foundations - NRC Publications Archive - Canada.ca](#)

UL Solutions Evaluation Report

settlement (~0-5 mm) during the temperature cycling. The soil freezing gradients and daily heave observations were consistent with expected soil behavior.

The COATLOK U-192 waterproofing membrane and SPF remained visually intact without any signs of deterioration, shearing or compression following 100 freeze-thaw cycling. The freeze-thaw conditioned materials were tested for waterproofing performance, maintaining a hydrostatic pressure resistance performance of greater than 48 kPa.

7. Installation

Installation of the waterproofing membrane and SPF must comply with this report and the manufacturer's published installation instructions. The manufacturer's published installation instructions are to be always available at the jobsite during installation.

- COATLOK U-192 and COATLOK PRE 206 primer installation must be by a trained installer in accordance with the manufacturer's directions.
- SPF installation must be by a licensed installer in accordance with the manufacturer's directions and follow CAN/ULC-S705.2 requirements.
- See Huntsman Building Solution COATLOK Application Guide, Rev: 01.27.22
- The waterproofing material is to be cured for a minimum 24 hr. period prior to any backfill being placed against the foundation wall.
- Protection board must be placed against the wall to protect the membrane during backfilling activities, see NBCC Sentence 9.13.3.4.(3) requirement.
- Backfilling activities to comply with NBCC Subsection 9.12.3.

8. Conditions of use

The COATLOK U-192 material described in this Report has been evaluated in accordance with code sections listed in Section 2.0, subject to the following conditions:

- Materials and methods of installation must comply with this report and the manufacturer's published installation instructions. In the event of a conflict between the manufacturer's published installation instructions and this report, the manufacturer shall be consulted.
- This product is manufactured in Boisbriand, QC., the manufacturing facility is under UL Solution audit of quality elements.
- A maximum 65 mm thickness of SPF may be applied to the concrete foundation wall prior to COATLOK U-192 application.
- Application of SPF as part of the waterproofing system limited up to building code Zone 7A with a maximum design 5999 HDD.
- Application of the COATLOK U-192 waterproofing limited to a maximum depth of 3 meters.

9. Supporting evidence

Huntsman Building Solutions has submitted technical documentation for UL Solutions review. Testing was conducted at ISO/IEC 17025 accredited laboratories. The test data submitted for this product is summarized below.

- Sample Selection of test materials at the Huntsman manufacturing facility by an ISO 17025 accredited testing laboratory.
- Test data in accordance with ULC-EC40477-01 by an ISO 17025 accredited testing laboratory.

UL Solutions Evaluation Report

- Test data in accordance with ASTM D5385 by an ISO 17025 accredited testing laboratory.
- Freeze-thaw cycling evaluation by University of Alberta Geotechnical Centre.

10. Identification

The Huntsman Building Solutions **COATLOK U-192** foundation waterproofing material described in this evaluation report is identified by a marking bearing the report holder's name (Huntsman Building Solutions), the plant identification, and the evaluation report number **ULC ER40477-01**. Product drums to be identified with expiry dates. The validity of the evaluation report is contingent upon this identification appearing on the product drums.

11. Client location / contacts

Huntsman Building Solutions
870 Cure-Boivin
Boisbriand, QC
J7G 2A7

866-437-0223
www.huntsmanbuildingsolutions.com

12. Use of UL Solutions Evaluation Report

- 12.1** The approval of building products, materials or systems is under the responsibility of the applicable code authorities.
- 12.2** UL Solutions Evaluation Reports shall not be used in any manner that implies an endorsement of the product, material or system by UL Solutions.
- 12.3** The current status of this report, as well as a complete directory of UL Solutions Evaluation Reports, may be found at UL.com/Solutions via Product iQ®.

UL Solutions Evaluation Reports

© 2023 Underwriters Laboratories of Canada Inc.

This UL Solutions Evaluation Report is not an endorsement or recommendation for use of the subject and/or product described herein. This report is not the UL Solutions Listing or Certification Report that covers the subject product. The subject product's UL Solutions Listing or Certification may be covered under a separate UL Solutions Report. UL Solutions disclaims all representations and warranties whether express or implied, with respect to this report and the subject or product described herein. Contents of this report may be based on data that has been generated by laboratories other than UL Solutions that are accredited as complying with ISO/IEC Standard 17025 by the International Accreditation Service (IAS) or by any other accreditation body that is a signatory to the International Laboratory Accreditation Cooperation (ILAC) Mutual Recognition Arrangement (MRA). The scope of the laboratory's accreditation shall include the specific type of testing covered in the test report. As the accuracy of any non-UL Solutions data is the responsibility of the accredited laboratory, UL Solutions does not accept responsibility for the accuracy of this data.

Underwriters Laboratories of Canada Inc.
7 Underwriters Road
Toronto, ON M1R 3A9 Canada
T: 800.463.6852
W: UL.com/Solutions